
This is the accepted manuscript version of the article

Durability of traditional clamped joints in the vapour barrier layer: experimental and numerical analysis.

Gullbrekken, L., Gradeci, K., Norvik, Ø., Rüter, P., & Geving, S.

Citation for the published version (APA 6th)
(2019). Durability of traditional clamped joints in the vapour barrier layer: experimental and numerical analysis. *Canadian Journal of Civil Engineering*, 1-5. Retrieved from <https://doi.org/10.1139/cjce-2018-0593>. doi:10.1139/cjce-2018-0593

This is accepted manuscript version.
It may contain differences from the journal's pdf version.

This file was downloaded from SINTEFs Open Archive

Durability of traditional clamped joints in the vapour barrier layer: Experimental and numerical analysis

Lars Gullbrekken¹, Klodian Gradeci¹, Øyvind Norvik², Petra Rüter¹ and Stig Geving²

¹SINTEF Building and Infrastructure, Høgskoleringen 7B, 7034, Trondheim, Norway

²Norwegian University of Science and Technology, Department of Civil and Environmental Engineering, Høgskoleringen 7a, 7034, Trondheim, Norway

Abstract

Clamped joints of wood frame buildings are a traditional way in Norway to attain airtight joints for the air and vapour barrier. Numerous defects registered in the SINTEF Building Defects Archive related to air leakage through the vapour barrier, on one hand, and stricter requirements for reduced energy consumption, on the other hand, questions today's efficacy of these type of joints. This study investigates the durability of clamped joints by studying how the airtightness is affected by several drying and wetting cycles. Experimental work is carried out to measure air leakage, that in turn, are used to evaluate their impact on the airtightness of two different constructions by numerical estimations. Results show that the air leakage rates are increased significantly due to transient climatic conditions. Clamped joints may no longer provide airtight building envelopes given the stricter requirements for energy consumption and implications of climate change. A more promising and robust alternative is the use of self-adhesive tapes.

Keywords: airtightness, air leakage, wood, clamped joints, building envelope, durability

23 **1. Introduction**

24 Air leakage and air infiltration through the building envelopes have a significant effect on the
25 buildings' energy performance and its indoor environment. Air leakage leads to higher energy
26 consumption, may result in moisture accumulation problems in the building envelope, and it may also
27 affect the indoor air quality (Airaksinen, Pasanen et al. 2003; Janssens and Hens 2003; Relander,
28 Holøs et al. 2012; Tuominen, Holopainen et al. 2014; Kalamees, Alev et al. 2017). Consequently,
29 airtight building solutions are crucial features that help ensure achieving energy efficient buildings,
30 avoid moisture problems during the building life cycle, meeting the increasingly stricter performance
31 requirements for reduced energy consumption of homes in Norway.

32
33 The requirements regarding reduced energy demand in buildings are continuously being tightened and
34 by 2020 all new buildings in Norway are required to be almost zero energy buildings (EPBD 2016;
35 TEK17 2017). Therefore, the requirements for airtightness in Norwegian building regulations were
36 strengthened in 2017, from 2.5 air changes per hour for residential buildings and 1.5 for other
37 buildings to, 0.6 for all buildings (TEK17 2017). Relander et al. (Relander, Holøs et al. 2012) have
38 shown that improving the airtightness of a residential building from the previous requirement to the
39 present one can save approximately 20 kWh/m² per year, which corresponds to more than 10% of the
40 average total energy consumption of a Norwegian household ((SSB) 2014). Considering this, the
41 energy efficiency of buildings can only be assured when the building envelope provides sufficient
42 airtightness.

43
44 The airtightness of the building envelope is achieved through the durability and connectivity of the air
45 barrier to other building components (Kalamees, Alev et al. 2017). Typical building envelope
46 constructions, both in Norway and other countries, use clamped joints as a traditional way to attain
47 airtight joints in the air- and vapour barrier. Nevertheless, a considerable number of building defects
48 registered in the SINTEF Building Defects Archive are related to air leakage through the vapour

49 barrier caused by convection. Considering these sources of building defects, it has been revealed that
50 moisture is the cause of 76 % of total building defect cases. Moisture from indoor air, including air
51 leakage through the vapour barrier, amounts to 15 % of the total number of building defect cases. On
52 the other hand, by additionally considering the more demanding requirements for lowering the energy
53 consumption in buildings, it is therefore questionable whether this traditional method provides
54 sufficient airtightness.

55
56 The airtightness of clamped joints depends on several parameters including the geometry of the tile
57 batten, type of fixing and its center to center distance. Some of these parameters have already been
58 investigated in several laboratory studies (Sagen, 2003; Bergby, 2011; Selmer, 2013) and the results
59 are summarized and discussed in (Gullbrekken et al., 2012a; Gullbrekken et al., 2012b). Sagen (2003)
60 carried out laboratory studies to investigate different types of fasteners of clamped joints in the air
61 barrier. It was found that the use of nails account for higher air leakage rates than screws. Wetting and
62 drying cycles resulted in higher air leakage due to shrinking and swelling of the wooden battens.
63 Shrinkage and swelling are caused by natural yearly variations in relative humidity of the indoor air of
64 Norwegian homes (Geving and Holme 2012). Bergby (2011) extended the previous laboratory
65 measurements by investigating different center to center distance between battens. It was confirmed
66 that screws as fasteners provided better airtightness than nails. In addition, the center to center
67 distance of 600 mm generally resulted in higher air leakage rates compared to shorter center to center
68 distances such as 300 mm and 150 mm.

69
70 Besides the geometrical parameters, the airtightness of clamped joints is also affected by the
71 prevailing microclimate and its impact. However, the effect of cyclic shrinking and swelling of wood
72 materials used in clamped joints and their influence on the airtightness of the building envelope have
73 not yet been investigated. The aim of this study was to investigate the durability of clamped joints by
74 studying how the airtightness is affected by several drying and wetting cycles caused by moisture

75 variations in the indoor environment. The durability of the joint is presumably unaffected by material
76 degradation, but the function is affected by the shrinking and swelling of the wooden batten. The
77 cyclic dimensional changes occurring due to variations in relative humidity are assumed to affect the
78 clamping effect over time. Furthermore, determining which design accounts for the best airtightness,
79 and the effect of applying adhesive tape were also investigated. Finally, a rough calculation of the
80 effects on the overall leakages rates was conducted. the materials investigated and the experimental
81 set-ups are presented in Section 2. In section 3 results of experimental investigations are given and
82 discusses; the results were further used as input for numerical estimations. Finally, conclusions are
83 drawn in section 4.

84 **2. Materials and methods**

85 **1.1. Experimental setup**

86 The cycling of the moisture level in the wooden battens was performed by placing the samples in a
87 sealed steel cabinet with a water reservoir at the bottom. The cabinet was again placed in a climate
88 chamber at a temperature of 70 °C.

89
90 To determine the moisture variations occurring in the batten on the inside of the vapour barrier, and
91 therefore the shrinking and swelling of the wood materials, simulations in WUFI-2D have been firstly
92 conducted (Kunzel, H. M., 1995). WUFI, a software developed by the Fraunhofer Institute of
93 Buildings physics, simulates hygrothermal conditions in building parts under transient climatic
94 conditions. In this study, a south-facing external timber frame construction was chosen. The
95 geographic location was Gardermoen, a weather station near Oslo in the south of Norway. The
96 climatic data included in WUFI is based on MDRY (Moisture Design Reference Year). There are
97 several possibilities to define the internal moisture development as a function of external temperature
98 (moisture load), further defined as the difference between the moisture content of the indoor and
99 outdoor air. Based on the findings of Geving & Holme (2012), the moisture development was defined

100 as "medium", corresponding to an internal moisture access of 4 g/m³ in the heating season with a
101 linear transition to 1.5 g/m³ at external temperatures above 15 °C. The results from these simulations,
102 which were conducted over a period of 5 years, showed that the moisture content in the construction
103 stabilizes after approximately six months and will afterwards oscillate between 7.8 % (weight) and
104 12.7 % for the inner half of the wood stud and between 9 % (weight) and 14,2 % for the wooden
105 batten. On the basis of these results, the target values for the experimental setup were chosen as 7 %
106 (weight) as the dry threshold and 14 % as the wet threshold value for the batten moisture content.

107

108 The samples chosen were Norway spruce studs, class C24 with chamfered edges. To limit the wetting
109 and drying time of the studs a reduced dimension of 36 x 98 mm was used. The reduced stud
110 dimension and therewith the reduced penetration depth of the screws was assumed not to have any
111 effects on the movements of stud and screws due to moisture variations. The battens were 36 x 48 mm
112 (with x depth). The length of the samples was limited to the inner height of the steel cabinet that again
113 was limited to the available space in the climate chamber. Thus, the samples length was 1000 mm.
114 For the vapour barrier, a commonly used PE foil with a thickness of 0.15 mm was used. Each sample
115 included two vertical joints with a total length of 1.8 m per sample (see **Error! Reference source not**
116 **found.**).

117

118 Three samples of each configuration were tested. Table 1 gives an overview of the samples and
119 parameters. The samples were placed vertically in the test cabinet, which was sealed and then again
120 put in the climate chamber (see **Error! Reference source not found.**). The measurements included
121 three drying and wetting cycles and are presented by chronological order in **Error! Reference source**
122 **not found.** In addition, the last test included sealing the clamped joint of all the samples by applying
123 adhesive tape to investigate the use of adhesive products on the airtightness of the joints. As such, the
124 airtightness of each sample was tested seven times.

125

126 Drying and wetting of the samples were performed in an oven at 70 °C. The wetting was performed
127 by installing the samples and a specific amount of water in a sealed air and water vapour tight box
128 positioned inside the oven. The temperature stratification inside the box was controlled by
129 thermocouples. During the drying and wetting, the wood moisture content was controlled by
130 measuring the electrical resistance between two electrodes positioned in two of the wood samples. All
131 the samples were weighed before undertaking the different airtightness measurements. Finally, the
132 moisture content of each measurement was calculated by measuring the dry weight of samples after
133 these were placed in the oven at 110 °C.

134 The resistance to penetration of air through pinched joints in the vapour barrier was tested when the
135 measured wood moisture content was close to the target values of 7 and 14%. The samples were
136 removed from the oven and air leakage through the clamped joint was then measured as quickly as
137 possible in laboratory conditions of 22°C ±2°C and 20 % RH ± 10%. The air leakage was measured in
138 accordance to EN 12114 (EN12114 2000). The air leakage was measured at a pressure difference of
139 20, 30, 50, 70 and 90 Pa. The air leakage at 50 Pa pressure difference was calculated by linear
140 interpolation of the measured values. The airtight box used for the moistening of the samples was also
141 used for the air leakage measurements. The PE-foil of the samples was positioned between a sealing
142 gasket on the airtight box and a sealing gasket on a wooden frame fixed with bolts with a specific
143 clapping force (see **Error! Reference source not found.**). The airtightness of the airtight box was
144 accounted for by measuring the air leakage at 50 Pa pressure difference with an airtight PE-foil as a
145 sample. This was done prior to the different test sequences.

146

147 2.2. Methods numerical estimations

148 To evaluate the practical implications of the measured air leakages two test buildings were
149 investigated. The resulting air change rate has been estimated by applying the results of air leakage as
150 retrieved from the experimental measurements. The estimated air change rate only included leakages
151 through the vapour barrier.

152 To calculate joint lengths in the two case houses some assumptions and simplifications were made:

- 153 • All air leakage in the buildings were through the clamped joints in the vapour barrier (no
- 154 leakages through the roof).
- 155 • PE-foil has a length of 15 m and a width of 2,6 m.
- 156 • Clamped joints were assumed at the bottom and head sills, corners and around the windows.

157 Some important information about the two case buildings are given in Table 2.

158 **3. Results and discussion**

159 **3.1. Results from experimental studies**

160 The results of the experimental measurements, provided in Figure 5, show that the initial test of the
161 samples using the traditional methods are very airtight. By drying the samples to approximately 6 %
162 (weight), an increase of the air leakage was observed. This is caused due to the shrinking of the batten
163 and the stud while the distance between the batten and the stud is fixed by the screws. Hence, the
164 shrinkage causes an increased air gap between the batten and the stud where air can leak, as shown in
165 **Error! Reference source not found..** By moistening the samples to a moisture level of
166 approximately 14 %, the air leakage of the samples w lowered. This is caused by the swelling of the
167 batten and stud which decreased the air gap between the batten and the stud and thereby reduced the
168 air leakage.

169
170 The measurements indicated that the air leakage through the clamped joints increased during the
171 drying and wetting cycles. This effect can be explained by the movements caused by the shrinkage
172 and swelling of the wood material which causes an increased stress on the joint of the screw and
173 wood. This effect is, as expected, dependent on the design of the screw. The length of the screw,
174 thickness and design of the thread will all affect the fastening capacity of the screw and wood
175 material. This could be a suggested topic of a future study. It is likely that further wetting and drying
176 cycles would further increase the air leakage through the clamped joints. The current study included

177 only three cycles, whereas the number of drying and wetting cycles during the life cycle of a building
178 could be presumed to exceed three cycles. Hence, there are still uncertainties concerning the long-
179 term durability of these type of clamped joints.

180

181 Even when applying adhesive tape to ensure airtight sealing, air leakage to some degree was still
182 measured. One possible explanation of air leakage through the taped joint can be that air leakage
183 occurs through the fastening fixing holes that perforate through the vapour barrier, as shown in
184 **Error! Reference source not found.** Nevertheless, the application of adhesive tapes lowered the air
185 leakage to some extent. A similar conclusion was drawn by Kreiger et al. (2015) and Kalamees et al.
186 (2017), where it was suggested that self-adhesive products may be a more promising and robust
187 solution to guarantee the airtightness of the building. Indeed, adhesive tapes are: a) easy to apply,
188 especially in renovations projects; b) they are cost-efficient; and, unlike other connecting measures, c)
189 they do not make holes and thus, offer fewer opportunities for air leakage. However, considering that
190 such solutions have been applied only during the past decades, there is still little knowledge of the
191 availability of adhesive tape products (Bracke, Van Den Bossche et al. 2014); especially, regarding
192 their durability, expected service life and evaluation and test methods. First, the service life of a
193 building or structure is often presumed to be 60 years (15686-1 2011). For building parts and
194 components, the expected service life varies depending on how accessible the respective building part
195 is for maintenance and replacement. Hence, the failure of these products is not easily observable, and
196 the repair or replacement is normally not technically nor economically feasible. Second, there exists
197 no up to date evaluation methods, guidelines or standards that can be used to help verify the durability
198 of adhesive joints when applied to vapour barrier system. Consequently, more research is required to
199 acquire knowledge and develop standards and guidelines regarding the long-term performance and
200 durability of adhesive solutions to achieve airtightness over the expected service life of a building.

201

202 3.2. Results from numerical estimations

203 **Error! Reference source not found.** and **Error! Reference source not found.** show the estimated
204 air change rate of the two case buildings based on the measurements of the initial air leakage, after the
205 third dry out, and after taping the joints using the assumptions in the previously described in Section
206 2.1. Note that the results assume no air leakage through the roof, floor, penetrations, and connections
207 between building parts. The code for the samples is explained as follows e.g. 450 is the center to
208 center distance between the fasteners in mm, correspondingly. The results generally indicate lower air
209 change rates for the office building compared to the single-family home. One explanation is a
210 different relation between the area of exterior walls and volume for the two buildings. Screws with a
211 centre to centre distance of 450 mm provided the largest calculated contribution to the air change rate.
212 However, the estimated air change rates at 50 Pa pressure difference through the joints of the vapour
213 barrier has a minor contribution compared to the requirements in the Norwegian building regulations.
214 The measured air change rate at 50 Pa pressure difference of a specific building consists of several
215 other air leakage sources among them air leakage through other building parts such as the roof,
216 window and floor as well as penetrations through the roof and wall assemblies. As further stated,
217 there are uncertainties concerning the long-term durability of these clamped joints. Previous research
218 shows that an airtight vapour barrier is important in avoiding condensation problems in roofs
219 (Janssens, A., Hens H. 2003). Further, Aho et al. (2008) state that an airtight building envelope, and
220 hence the use of a vapour barrier, is an essential element of the envelope assembly to avoid local
221 moisture accumulation that in turn can cause moisture problems such as the formation of surface
222 mould or decay of timber structures.

223

224 4. Conclusions and further work

225 In this study experimental measurements and numerical estimations were carried out to investigate the
226 effect of cyclic drying and wetting conditions on clamped joints of wood frame constructions. The

227 impact of cyclic drying and wetting of these joints on the airtightness of two case buildings was also
228 investigated. Experimental results showed the airtightness of clamped joints was reduced due to the
229 cyclic conditionings. However, there still remain uncertainties concerning the long-term durability of
230 these clamped joints. A more promising and robust alternative solution to render the building
231 envelope airtight could be the application of self-adhesive tapes. More research is required to acquire
232 knowledge and develop standards regarding the long-term performance and durability of self-adhesive
233 tapes to achieve the required airtightness over the expected service life of buildings in Norway.

234 **Acknowledgments**

235 This study was funded by the project 'TightEN - Durable adhesive airtight solutions for energy
236 efficient building envelopes' (www.tighten.no), which is intended for the development of robust test,
237 evaluation and prediction methodologies to ensure durable adhesive airtight solutions for energy
238 efficient building envelopes. Research Council of Norway; Country: Norway; Grant number: 294894.

239 **References**

- 240 Aho, H., Vinha, J., Korpi, M. 2008. *Implementation of airtight constructions and joints in residential*
 241 *buildings*. In *The Nordic Journal of Building Physics, The 8th symposium on Building Physics in*
 242 *the Nordic Countries June (Vol. 16)*.
- 243 (SSB), S. N. 2014. "Energy consumption in households - Average energy consumption per household
 244 per m2 dwelling area."
- 245 Airaksinen, M., Pasanen P. O, Kurnitski J., Seppänen O. 2003. "Microbial contamination of indoor air
 246 due to leakages from crawl space: a field study." *Indoor air* **14**: 55-64.
- 247 Bergby J.C. 2011 Lufttetthet av klemte skjøter i vind- og dampsperrsjikt. Master thesis, NTNU
 248 institutt for bygg, anlegg og transport Trondheim. (In Norwegian)
- 249 Bracke, W., Van Den Bossche N., Janssens A. 2014. *Airtightness of building penetrations: air*
 250 *sealing solutions, durability effects and measurement uncertainty*. 35th Conference: Ventilation
 251 and airtightness in transforming the building stock to high performance (AIVC-2014), AIVC.
- 252 EPBD, C. A. 2016. "Implementing the Energy Performance in Buildings Directive (EPBD)." *CA*
 253 *EPBD III, Lisbon, Portugal: CA EPBD*.
- 254 EN12114 2000 Thermal performance of buildings - Air permeability of building components and
 255 building elements - Laboratory test method. Standard Norge
- 256 Geving, S. and Holme J. 2012 "Mean and diurnal indoor air humidity loads in residential buildings."
 257 *Journal of Building Physics* **35** (4): 392-421
- 258 Gullbrekken L, Bergby J.C, Geving S, et al. 2012a *Measurements of air leakage through clamped*
 259 *joints*. 7th International BUILDAIR Symposium. Stuttgart. Germany
- 260 Gullbrekken L, Bergby J.C, Uvsløkk S, et al. 2012b *Improvement of traditional clamped joints in*
 261 *vapour- and wind barrier layer for passive house design*. Passivhus Norden conference.
 262 Trondheim. Norway

- 263 ISO15686-1 2011. Buildings and Constructed Assets - Service Life Planning - Part 1: General
264 principles and framework.
- 265 Janssens, A., H. Hens 2003. "Interstitial condensation due to air leakage: a sensitivity analysis."
266 *Journal of Thermal Envelope and Building Science* **27**(1): 15-29.
- 267 Kalamees, T., Alev Ü., Pärnalaas M 2017. "Air leakage levels in timber frame building envelope
268 joints." *Building and Environment* **116**: 121-129.
- 269 Kreiger, M., Alvey J., Chu D. 2015. "Environmental degradation effect on airtightness of pressure-
270 sensitive adhesive exterior housing tapes on plywood." *ASHRAE Transactions* **121**: 130.
- 271 Kunzel, H. M., 1995 Simultaneous heat and moisture transport in buildings components – one- and
272 two-dimensional calculation using simple parameters. (PhD). IRB Verlag, Germany.
- 273 Relander, T.O., Holøs S. and Thue J. V. 2012. "Airtightness estimation—A state of the art review and
274 an en route upper limit evaluation principle to increase the chances that wood-frame houses with a
275 vapour-and wind-barrier comply with the airtightness requirements." *Energy and Buildings* **54**:
276 444-452.
- 277 Sagen V. 2003 Vindsperrers lufttetthet avhengig av fuktighet og festemåte av klemlektene.
278 Eksperimentelle undersøkelser. Master thesis, NTNU Institutt for bygg, anlegg og transport
279 Trondheim. (In Norwegian)
- 280 Selmer J.B. 2013 Festemidlers innflytelse på lufttetthet av klemte skjøter i vind- og dampspærresjikt.
281 Master thesis, NTNU Institutt for bygg, anlegg og transport Trondheim. (In Norwegian)
- 282 TEK17 2017. Forskrift om tekniske krav til byggverk. [Regulations on technical requirements for
283 buildings]. Kommunal og moderniseringsdepartementet. Oslo. Norway. (In Norwegian)
- 284 Tuominen, P., R. Holopainen, L. Eskola, J. Jokisalo, M. Airaksinen (2014). "Calculation method and
285 tool for assessing energy consumption in the building stock." *Building and Environment* **75**: 153-160.
286
287
288

289 **List of Tables**

290

291 *Table 1 Overview over samples and their configuration*

Sample	Stud (width x depth x length) [mm]	Batten width x depth [mm]	Center distance [mm]	Screws/Fastening¹	Number of samples
SK450	36 x 98 x 1000	36 x 48	450	Wood screw, 6.0 x 120	3
SK300	36 x 98 x 1000	36 x 48	300	Wood screw, 6.0 x 120	3
SK150	36 x 98 x 1000	36 x 48	150	Wood screw, 6.0 x 120	3

¹ The screwing pressure was set to and immersion of approx. 1-2 mm


292

293


294 *Table 2. Input data for the calculations of the case buildings.*

	Single family house	Office building
Heated area [m ²]	140	12870
Heated volume [m ³]	336	46191
Total clamped joint length [m]	320	5052

295

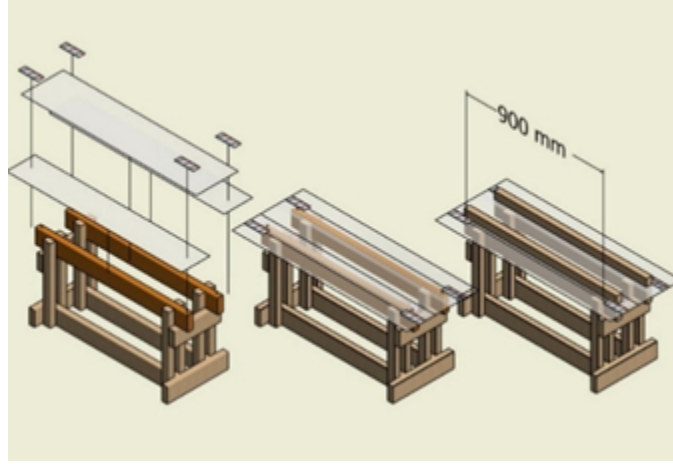


Mounting of the test samples.

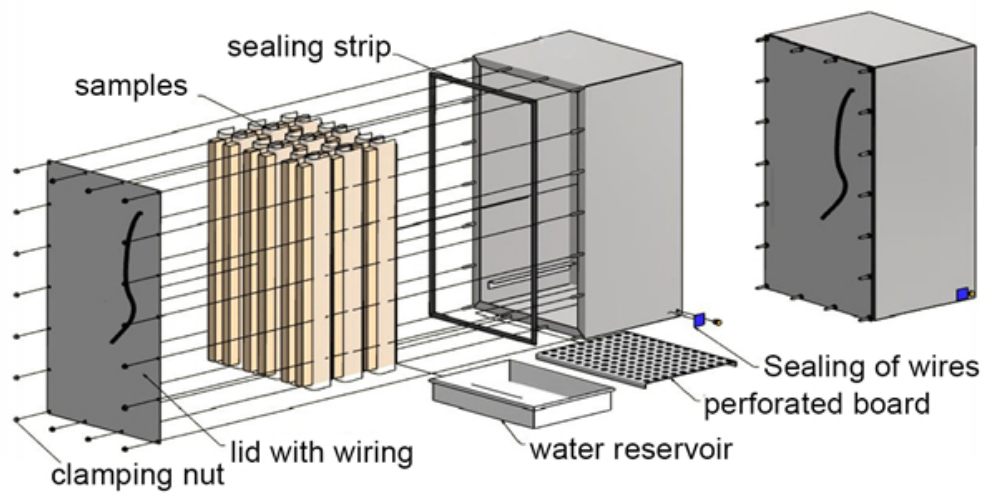


Configuration of the experimental setup.




Test cycles sequence.

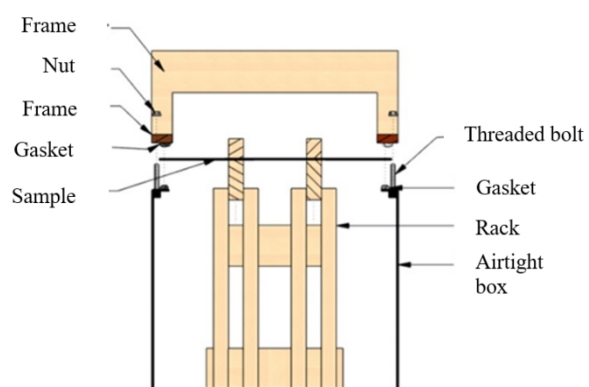


Fixing of the different samples to the airtight box.

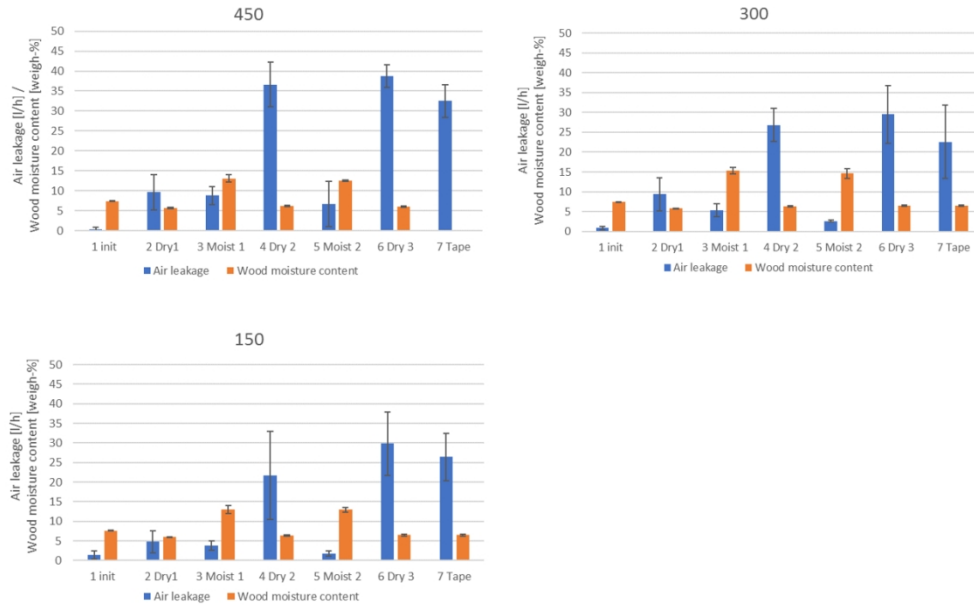

Air leakage through the different samples before and after drying and moistening. The code e.g. " 450" means the centre to centre distance of the fasteners in mm.

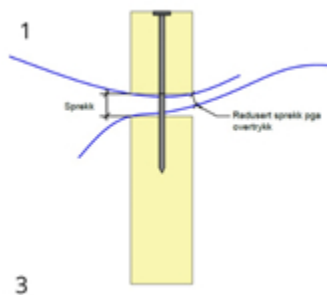

Shrinkage of the batten and the stud reduces the clamping effect leaving a air gap between the batten and the stud.

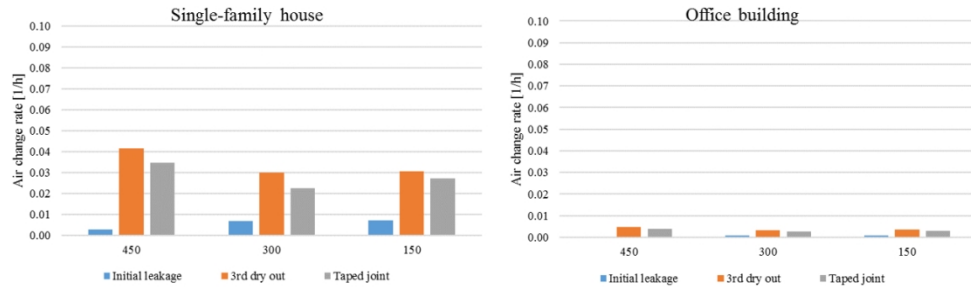

Estimation of air change rate of the single-family house and office building using assumptions in the presented in section 2.